




Appendix A: Stage 1, Assembly point A



Emergency Exit

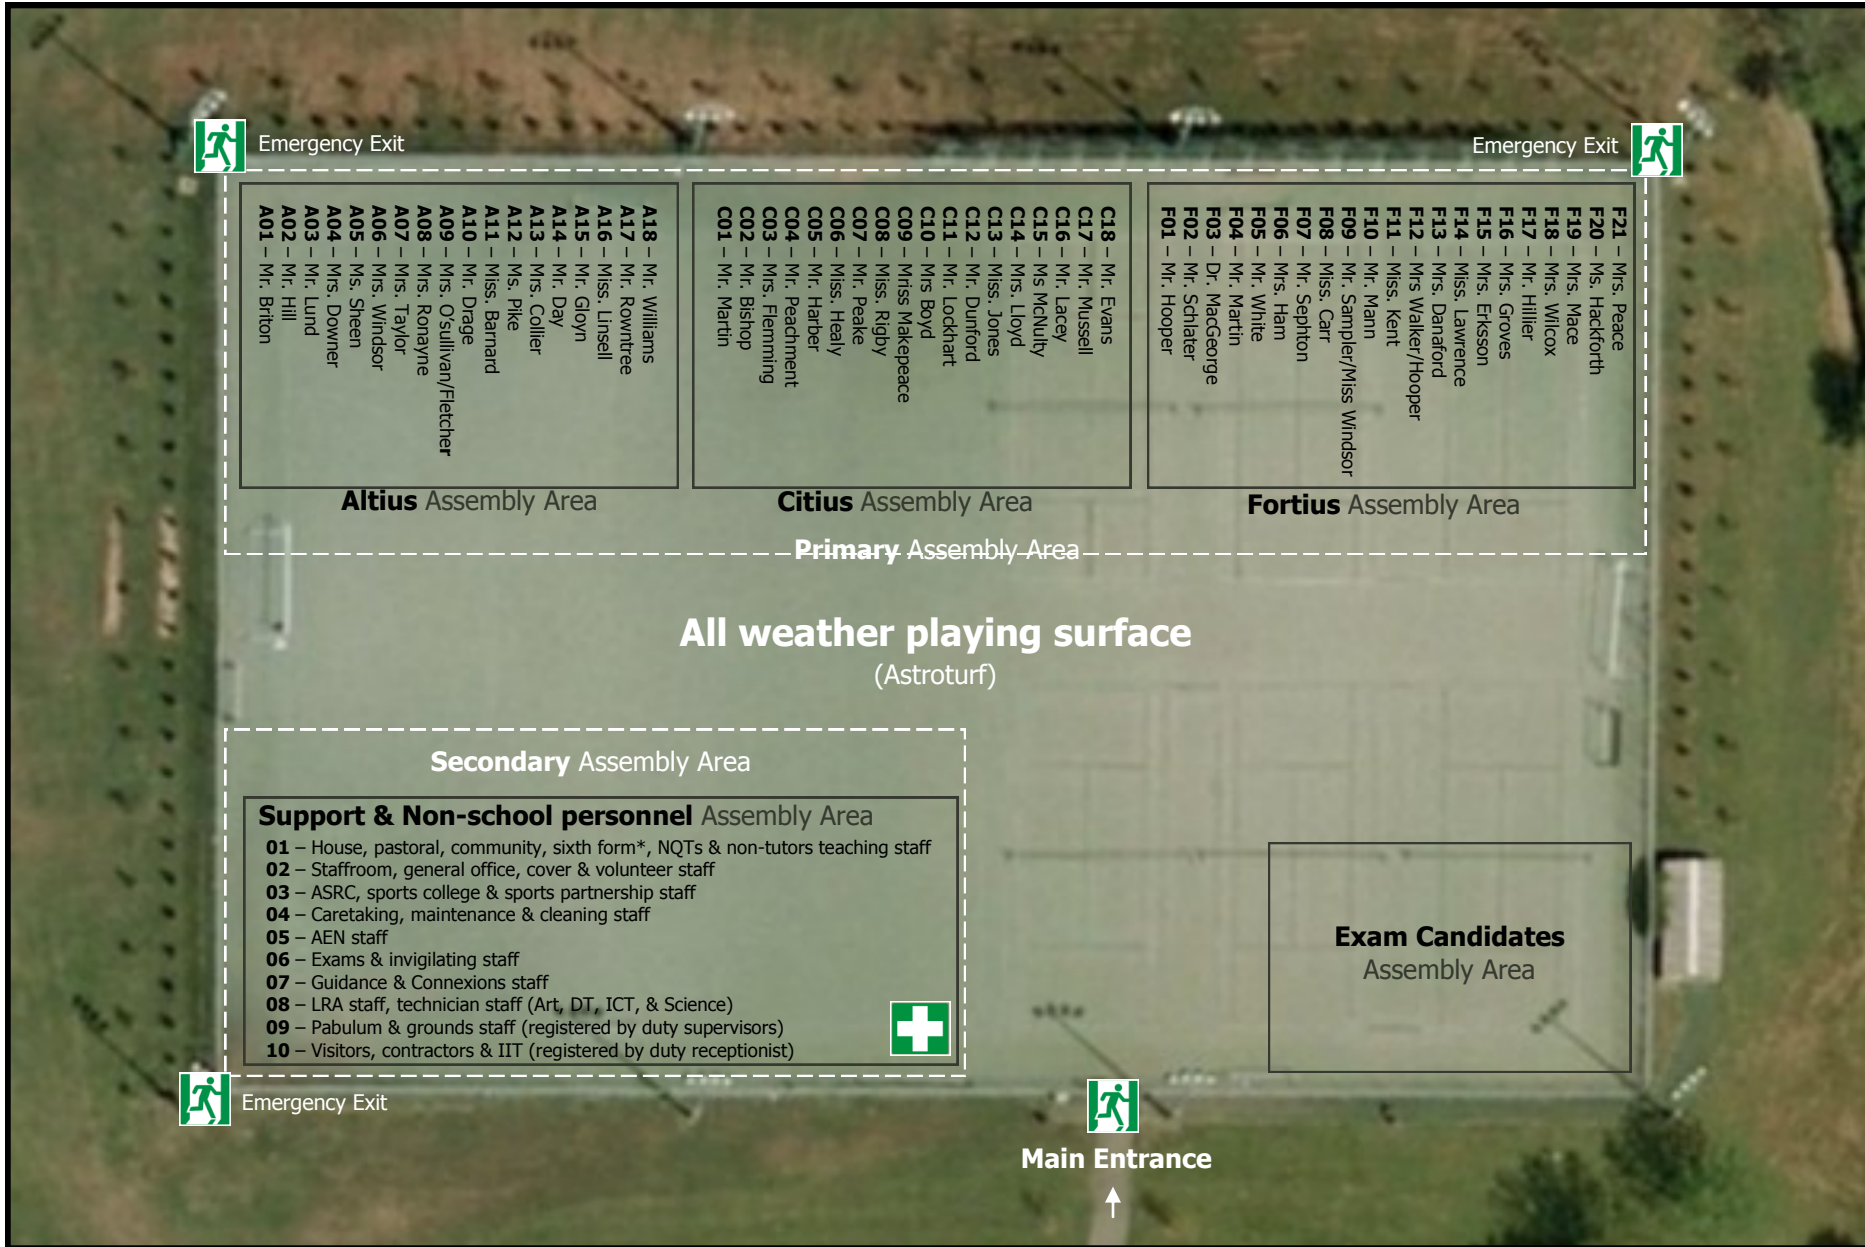

Emergency Exit

- A18 – Mr. Williams
- A17 – Mr. Rowntree
- A16 – Miss. Linsell
- A15 – Mr. Gloyn
- A14 – Mr. Day
- A13 – Mrs. Collier
- A12 – Ms. Pike
- A11 – Miss. Barnard
- A10 – Mr. Drage
- A09 – Mrs. O'Sullivan/Fletcher
- A08 – Mrs. Ronayne
- A07 – Mrs. Taylor
- A06 – Mrs. Windsor
- A05 – Ms. Sheen
- A04 – Mrs. Downer
- A03 – Mr. Lund
- A02 – Mr. Hill
- A01 – Mr. Britton

Altius Assembly Area

- C18 – Mr. Evans
- C17 – Mr. Mussell
- C16 – Mr. Lacey
- C15 – Ms McNulty
- C14 – Mrs. Lloyd
- C13 – Miss. Jones
- C12 – Mr. Dunford
- C11 – Mr. Lockhart
- C10 – Mrs Boyd
- C09 – Miss Makepeace
- C08 – Miss. Rigby
- C07 – Mr. Peake
- C06 – Miss. Healy
- C05 – Mr. Harber
- C04 – Mr. Peachment
- C03 – Mrs. Flemming
- C02 – Mr. Bishop
- C01 – Mr. Martin

Citius Assembly Area

- F21 – Mrs. Peace
- F20 – Ms. Hackforth
- F19 – Mrs. Mace
- F18 – Mrs. Wilcox
- F17 – Mr. Hillier
- F16 – Mrs. Groves
- F15 – Mrs. Eksson
- F14 – Miss. Lawrence
- F13 – Mrs. Danford
- F12 – Mrs Walker/Hooper
- F11 – Miss. Kent
- F10 – Mr. Mann
- F09 – Mr. Sampler/Miss Windsor
- F08 – Miss. Carr
- F07 – Mr. Sephton
- F06 – Mrs. Ham
- F05 – Mr. White
- F04 – Mr. Martin
- F03 – Dr. MacGeorge
- F02 – Mr. Schlater
- F01 – Mr. Hooper

Fortius Assembly Area

Primary Assembly Area

All weather playing surface
(Astroturf)

Secondary Assembly Area

Support & Non-school personnel Assembly Area

- 01 – House, pastoral, community, sixth form*, NQTs & non-tutors teaching staff
- 02 – Staffroom, general office, cover & volunteer staff
- 03 – ASRC, sports college & sports partnership staff
- 04 – Caretaking, maintenance & cleaning staff
- 05 – AEN staff
- 06 – Exams & invigilating staff
- 07 – Guidance & Connexions staff
- 08 – LRA staff, technician staff (Art, DT, ICT, & Science)
- 09 – Pabulum & grounds staff (registered by duty supervisors)
- 10 – Visitors, contractors & IIT (registered by duty receptionist)



Emergency Exit



Main Entrance



Exam Candidates
Assembly Area

Wheelchair users and persons with limited mobility should assemble at the Stage 2, Assembly point B which is a more suitable location for ease of egress should site evacuation be necessary.

